

## HEAT PRODUCED WITH SOLID BIOMASS BOILER



### Network:

- 325 kW Maximum output
- 6 % Output demand of heating network, % of max = 20 kW

### Biomass boiler:

- 195 kW Max output of boiler with chosen fuel
- 60 % Biomass boiler of max output = 195 kW
- 10 % Min output biomass boiler can be run = 20 kW
- 5 vrk Service break in summer
- 99 % Biomass boiler in use, 2,6 d boiler not in use

**96,4 % of heat produced with biomass boiler**

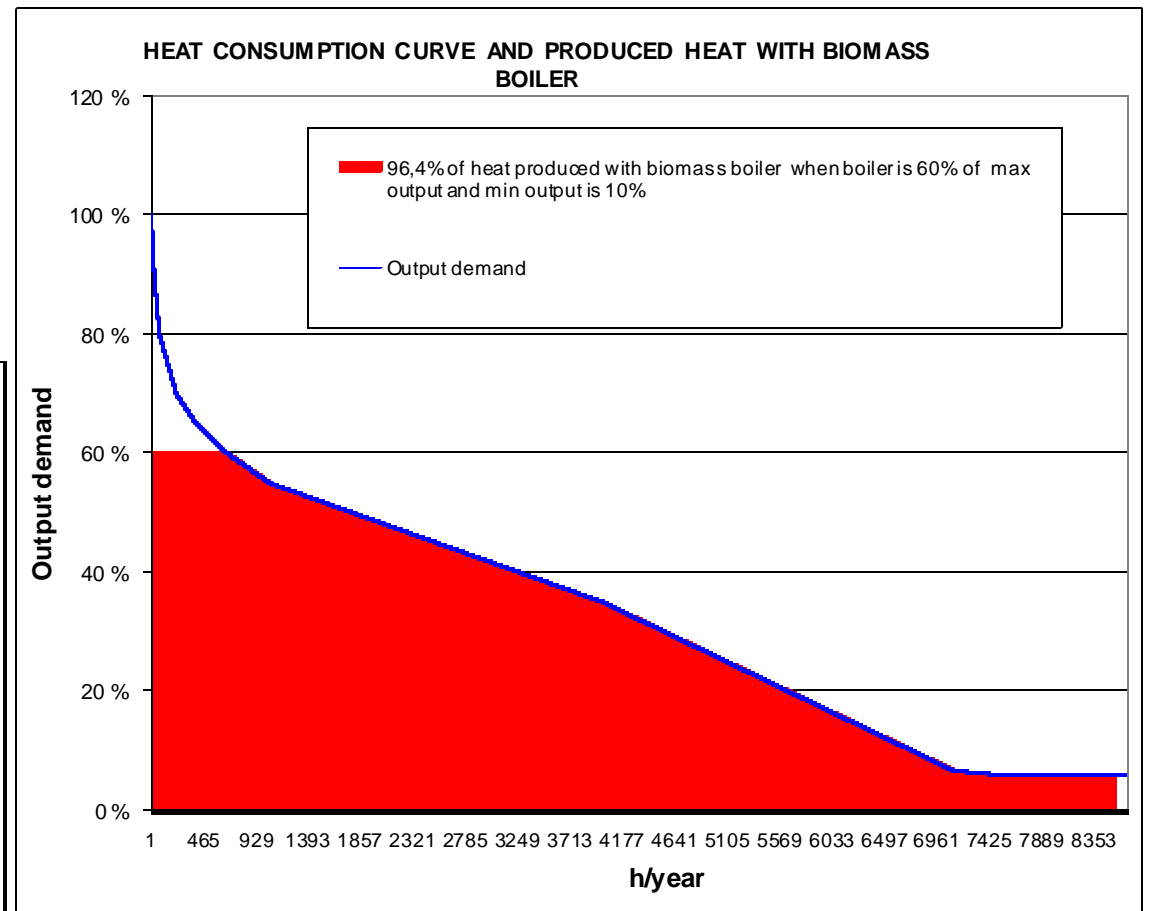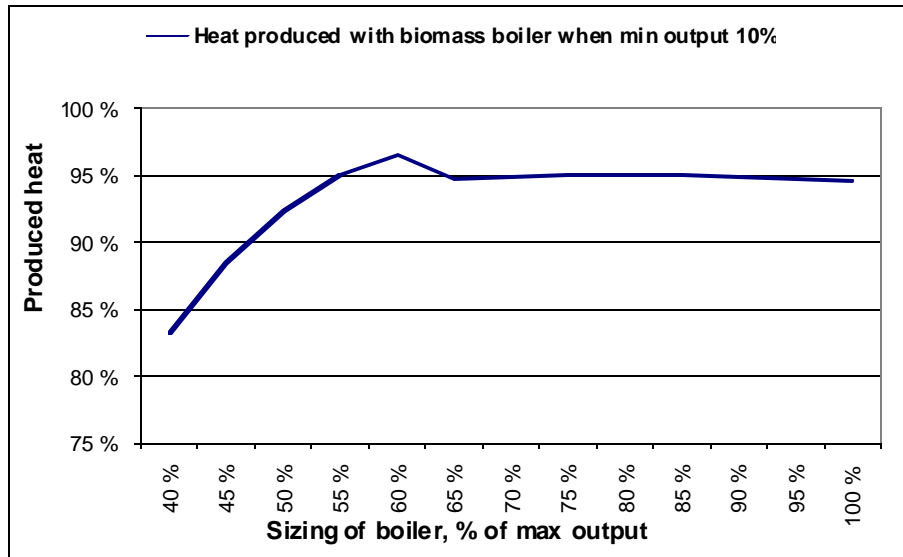

Calculator:

veli-pekka.kauppinen@metsakeskus.fi

Modified by VTT

Consumption curve:

Ääneseudun Energia Oy